

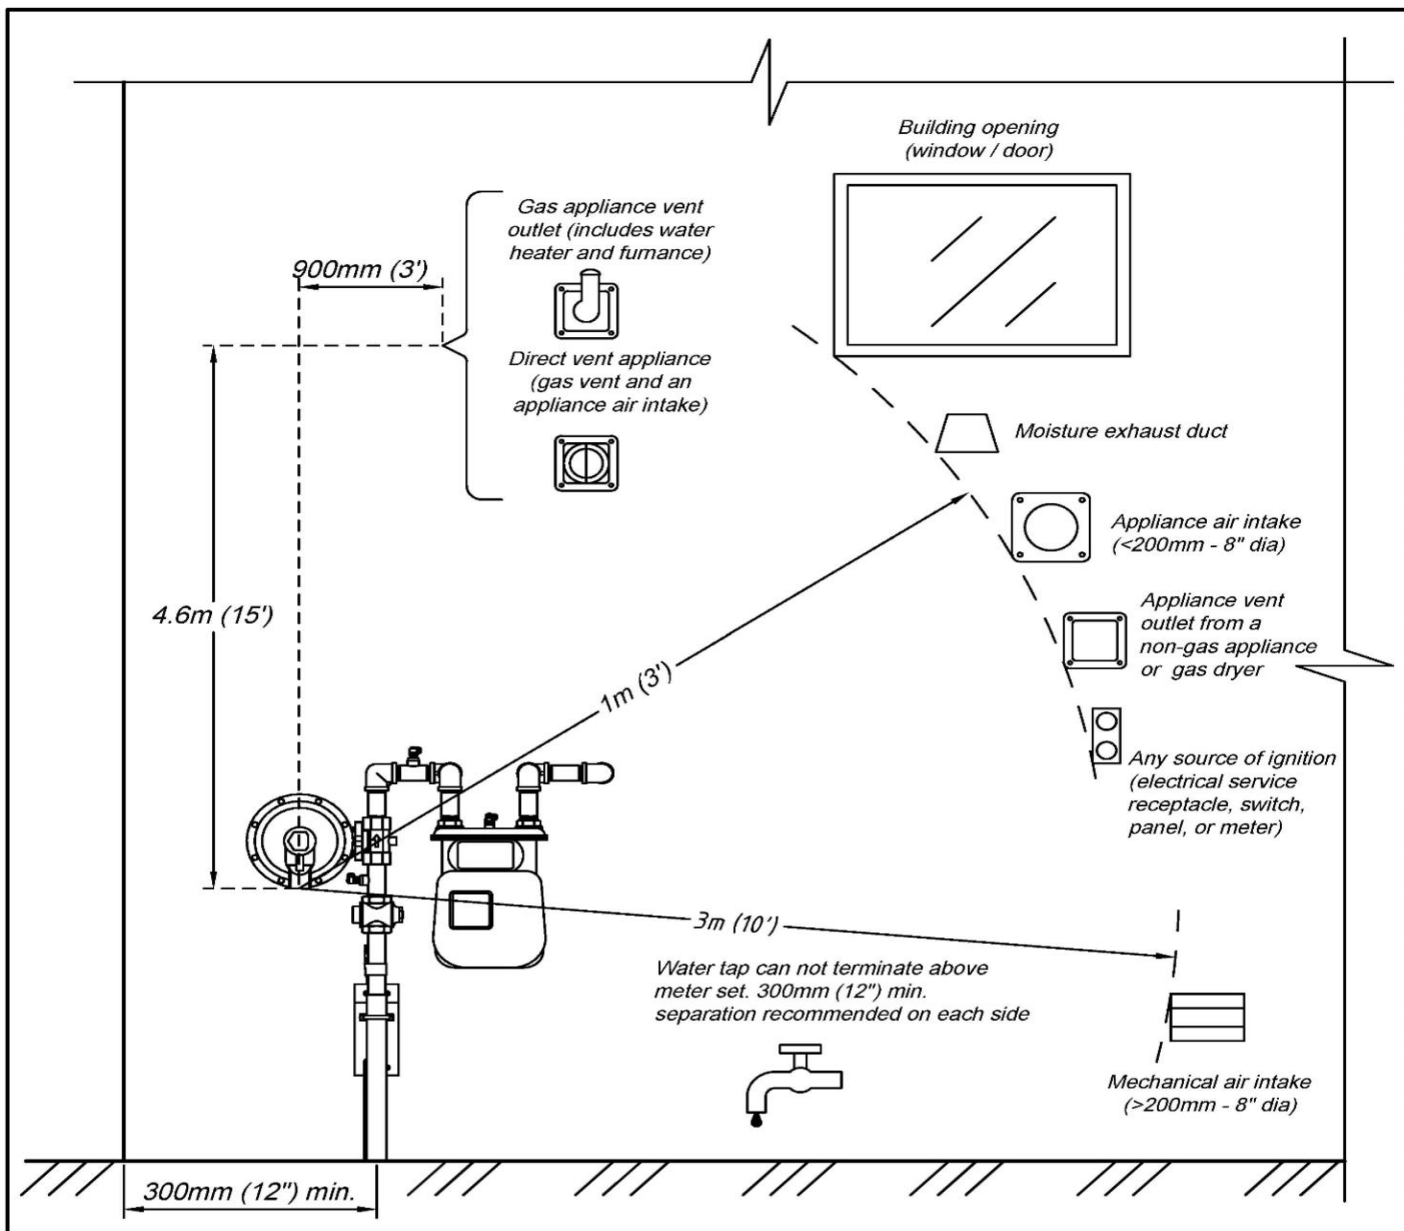


FIGURE 5.2 LOCATION OF REG. VENT RELATIVE TO BUILDING OPENINGS

NOTES:

1. All clearances listed are in accordance with CSA B149.1;
2. If these clearances cannot be met, CSA 6.22 regulator/relief may be used. See table 5.2 in CSA B149.1 for acceptable clearances.

Alberta